



MODEL K75 TYPE NB (THINLINE)

UL CLASSIFIED 3 HOURS RATING

APPLICATION

MODEL K75-N is approved for use in walls, floors and partitions with fire resistance ratings of 4 hours and less.

STANDARD CONSTRUCTION

FRAME

2" (51mm) maximum x 22 (0.85mm) gauge galvanized steel channel.

BLADES

22 (0.85mm) gauge galvanized steel curtain type out of the air stream.

FINISH

Mill.

CLOSURE SPRINGS

301 stainless steel spring.

FUSIBLE LINK

Standard 165° F (74°C). Others available.

MOUNTING


Vertical

MINIMUM SIZE

Vertical installation :
4"W x 4"H (100 x 100mm).
Horizontal installation:
4"W x 4"H. (100 x 100mm).

MAXIMUM SIZE


Single section
Vertical installation:
48" W x 44" H. (1219 x 1118mm)

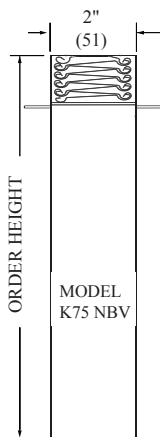

(V) VERTICAL MOUNT

FEATURES

- *Slim profile design for minimum clearance applications.
- *Each damper is marked with a 3 hours UL 555 classified fire damper label.
- *Meets all UL and NFPA criteria for primary fire dampers in walls and floors with fire resistance ratings of 4 hours and less.

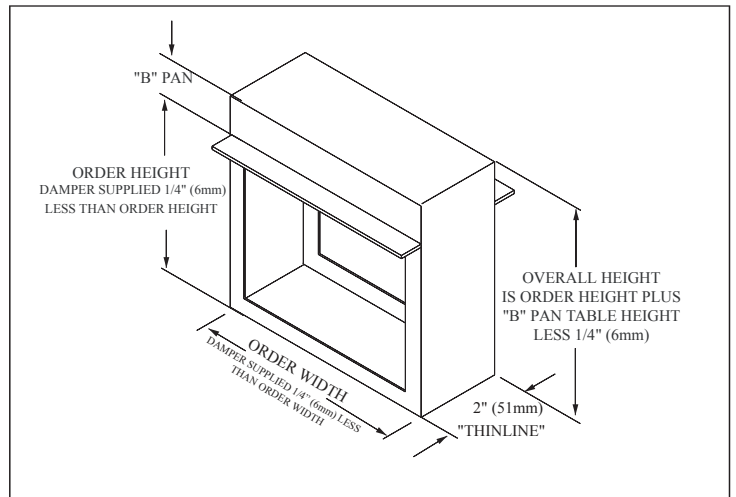

VARIATION.

All UL Classified fire dampers must be fabricated in accordance with UL procedures. Available variation are limited to those incorporated in the approved procedures. Approved variations available at additional cost are :

- *Factory furnished sleeves.
- Sleeves are available in 10 (3mm) through 20 (1mm) gauge steel and in lengths required for the specific application.

NOTES.

- * Dampers furnished approximately 1/4"(6mm) smaller than given duct dimension
- * Refer to the KBE Installation Instruction and supplements for complete installation details.



UNDERWRITERS LABORATORIES (UL 555)
CLASSIFIED FIRE DAMPERS.
FIRE RESISTANCE RATED 3 HOURS.
FOR USE IN UL CLASSIFIED BUILDING
MATERIALS RATED 4 HOURS OR LESS.